

* INFORMATION GATHERED IS PROVIDED TO THE GOVERNMENT REGULATOR (ECCC) AND SELECTED RESPONDERS WITHIN THE COMPANY (GIBSON ENERGY). ALL COPIES ARE DESTROYED AFTER OPERATIONS HAVE CEASED.

ALERT	ON-SITE ONLY - Immediate control of the hazard will progress resolution of the solution. There is no risk to the public or environment as the incident is contained to the site.
LEVEL 1	LOW IMPACT - Public, personnel and environment are not at serious risk and on-site personnel can control the incident. The incident is usually confined to the company.
LEVEL 2	MODERATE IMPACT - Public, personnel or the environment are at definite risk and external assistance is required to control the situation. Media coverage is possible and the incident has an effect outside the company boundaries. External and provincial agencies must be notified.
LEVEL 3	HIGH IMPACT - Control of the situation has been lost and presents or has caused a hazard to public, personnel and / or the environment, on or off company property. Immediate multi-agency and provincial government involvement is required.

LEVELS OF EMERGENCY

Although the probability of an incident is low, Gibson is taking advance preparations to ensure your safety. Gibson would like to ensure:

- 1 You are aware of the Emergency Response Plan and understand how it functions.
- 2 You are aware of the Reception Centre(s) and their locations.
- 3 You are advised of methods of communication to be used in case of an emergency.

Gibson obtains the confidential* information it may need to contact each business in the immediate area.

WHY ARE YOU BEING CONTACTED?

Substance	DILUENT	DRUBIT/DILBIT
CAS Number	64741-47-5	128683-25-0
	68919-39-1	8002-05-09
Quantity	1 @ 4,7626m ³	1 @ 23,809 m ³ 1 @ 3,968 m ³
Facility Storage	2600 m	662 m
EPZ		

As part of the public safety process, Gibson Energy has created this information pamphlet and an area specific emergency response plan (ERP). You are being contacted to make certain that you understand your role in the emergency response process. Located within M.D. of Provost No. 52, Gibson's DRU Facility has Cude Oil and Condensate storage bulets, making it an Environment and Climate Change Canada (ECCC), CEPA registered facility.

OVERVIEW

24 HOUR EMERGENCY NUMBER 1-866-553-0111



Please review and familiarize yourself with the information in this pamphlet.

DRU FACILITY

GIBSON ENERGY CONTACTS

DRU Control Room	Admin: 780-888-8262
Hardisty Main Office	Admin: 780-888-8200
Todd Baumgartner Sr. EH&S Advisor	Cell: 780-252-0003

GOVERNMENT CONTACTS

AER - Emergency Response Line	24-Hr: 800-222-6514
M.D. of Provost No. 52	780-753-2434

This Information Pamphlet is Environment Canada Regulated.

RECEPTION CENTRES

Hardisty Community Hall 4807 49 Street, Hardisty, AB	Admin: 780-888-3623
Amisk Community Centre 1209 27 Street, Wainwright, AB	Admin: 780-856-2433

CLICK BEFORE YOU DIG

When work needs to be done within 30 metres of the pipeline Right of Way, you can arrange to have the pipeline located for you within 48 hours, **free** of charge.

This service can be arranged by visiting the following website:

<http://www.albertaonecall.com>

Or by phone:

1-800-242-3447 (Call Toll Free)

GIBSON ENERGY 24 HOUR EMERGENCY NUMBER 1-866-553-0111

EMERGENCY PROCEDURES

At any level of emergency, roadblocks would be set up around the Emergency Planning Zone (EPZ) to keep traffic out of the hazard area. Residents in the immediate area would be contacted, given an update of the situation and instructed on which precautions to take. Emergency Awareness Zone (EAWZ) is identified on the map for reference purposes only.

In the event the EPZ had to be evacuated, a reception centre would likely be set up at one of the locations identified on the front of this pamphlet.

In some cases, there may be concern that evacuation would expose people to greater hazard than if they remain in their homes. Buildings provide a supply of clean indoor air to dilute contaminated air that infiltrates from outdoors, thus reducing the concentrations to which the occupants are exposed. Therefore sheltering may be considered as an alternative to evacuations for short durations.

EARLY NOTIFICATION

If you are indoors, close all doors and windows and turn down the furnace, and thermostat immediately. In the summer, turn off all air conditioning.

- 1) If you are indoors, close all doors and windows and turn down the furnace, and thermostat immediately. In the summer, turn off all air conditioning.
- 2) DO NOT use any forms of ignition (lighters, fire places, wood stoves, etc.).
- 3) Notify Gibson personnel via the contact information found on the front of this pamphlet. If unable to contact Gibson personnel, call their 24-hour emergency number. You may also contact the AER (see front panel) and report the odour. Immediate action will be taken by the AER to determine the source of the odour.
- 4) If you are considering leaving the area, contact the licensee representative, the municipality, or the AER for evacuation instructions. For major incidents, a special number may be provided, which should be called.
- 5) If environmental monitoring indicates that the release may impact members of the public, an evacuation will be carried out under the direction of authorized emergency personnel.
- 6) If you are directed to evacuate, follow the instructions that will safely move you away from the source and out of harm's way. You will also be provided with instructions to check in and register at a reception centre that is located in a secure and safe place.

WHAT TO DO

NOTES

PROCEDURE FOR EVACUATION

If it is necessary to evacuate, you will be contacted by telephone immediately. If you require voluntary evacuation assistance, have special needs considerations, or if there is no answer to our telephone calls, Gibson will dispatch personnel to your residence or business to verify your location and inform you of the situation. Special needs considerations include residents who may require transportation, residents who do not have a telephone on-site and / or residents that have health or respiratory problems.

The steps below should be followed if "Evacuation" procedures have been implemented:

- Gather all residents and bring any medicines required.
- Lock all windows and doors.
- Turn down thermostat and shut off any air exchange fans to outside.
- Drive safely on the route provided, proceed directly to the reception centre and check in with the representative.
- Wait for further instruction.

In some cases, there may be concern that evacuation would expose people to greater hazard than if they remain in their homes. Buildings provide a supply of clean indoor air to dilute contaminated air that infiltrates from outdoors, thus reducing the concentrations to which the occupants are exposed. Therefore sheltering may be considered as an alternative to evacuations for short durations.

While the chance of an uncontrolled release of oil and/or gas is remote, the emergency response plan for this area is in place to ensure your safety.

SHELTER-IN-PLACE PROCEDURE

PUBLIC PROTECTION MEASURES

POTENTIAL HEALTH IMPACTS

DILUENT

Diluent (also known as Condensate) is a pale yellow to brown liquid with a petroleum odour. It is a hydrocarbon mixture separated as a liquid from natural gas during the production process and used for feedstock for Petroleum Refineries. Diluent contains benzene, a proven human carcinogen.

Main Hazards:

- Extremely flammable
- High fire hazard
- Vapors may travel to source of ignition and flash back. Vapors will spread along ground and collect in low or confined areas (sewers, basements, tanks)

Health Impacts:

- Inhalation or contact with material may irritate or burn skin and eyes
- Fire may produce irritating, corrosive and/or toxic gases
- Vapors may cause dizziness or suffocation
- Runoff from fire control or dilution water may cause pollution

DILBIT

Dilbit is the combination of Oil Sands Crude Oil (~70-75%) and Diluent (~25-30%). Diluent products are also known as Condensate. Diluent is added to increase the viscosity of the Oil Sands Crude Oil so that it can be transported via pipelines. Dilbit contains benzene, a proven human carcinogen.

Main Hazards:

- Extremely flammable as both a liquid and a vapor.
- Vapors may travel to source of ignition and flash back. Vapors will spread along ground and collect in low or confined areas (sewers, basements, tanks)
- Runoff to sewer may create fire or explosion hazard

Health Impacts:

- Inhalation or contact with material may irritate or burn skin and eyes
- Fire may produce irritating, corrosive and/or toxic gases
- Vapors may cause dizziness or suffocation
- Runoff from fire control or dilution water may cause pollution

DRUBIT

Crude oil is dark brown or black liquid with a petroleum smell. It is a mixture of naturally occurring hydrocarbons that is refined into thousands of products. It is feedstock for refineries where it undergoes distillation. This process breaks the liquid down into various products of different weight, depending on the exact composition of the liquid. The majority of crude is used for gasoline, jet fuel, diesel, and heating oils. Heavier products are used to make tar, asphalt, paraffin wax, and lubricating oils.


Main Hazards:

- Low flammability
- Potential vapors may travel to source of ignition and flash back. Vapors will spread along ground and collect in low or confined areas (sewers, basements, tanks)

Health Impacts:

- Inhalation or contact with material may irritate or burn skin and eyes
- Fire may produce irritating, corrosive and/or toxic gases
- Vapors may cause dizziness or suffocation
- Runoff from fire control or dilution water may cause pollution

*Hazards are listed in order to bring awareness to potential hazards, the likelihood of being exposed to these hazards are very low.

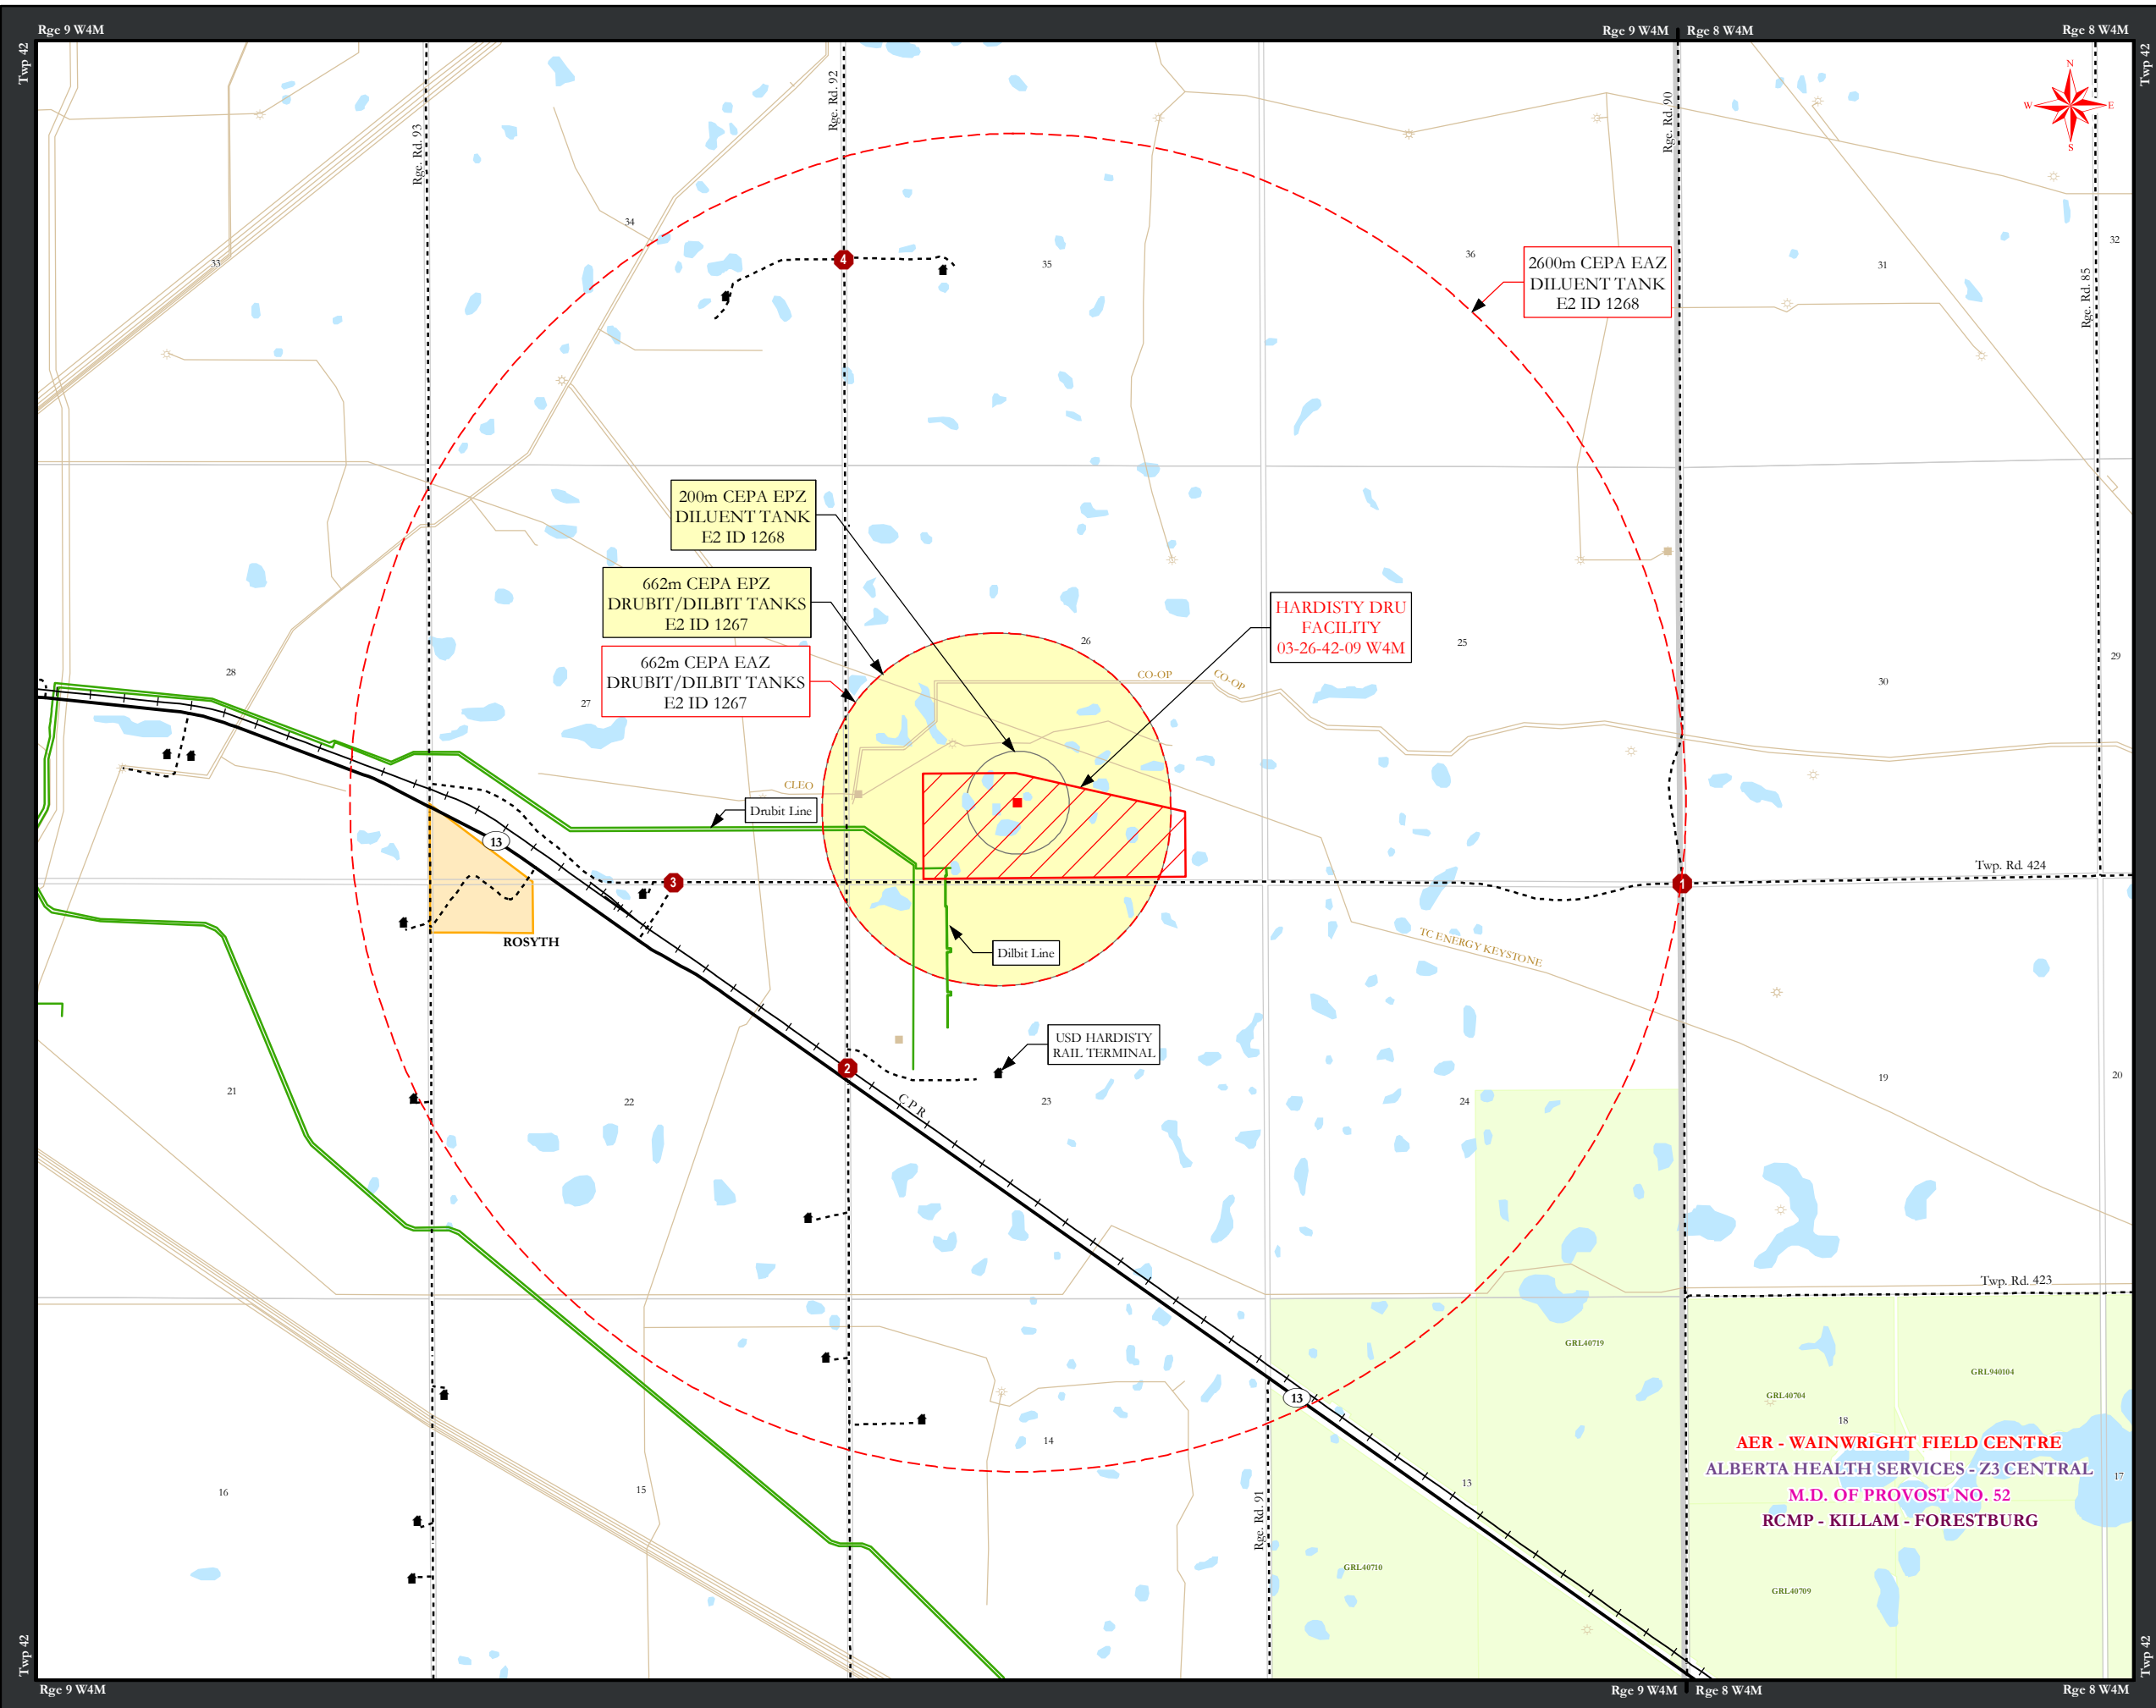

HARDISTY DRU FACILITY

03-26-42-09 W4M




Draft Date: March 9, 2021 DC Scale: 1:25,000 Map: 12194
 Revision Date: March 10, 2021 DC UTM ZONE 11 NAD83



- | | |
|----------------------|----------------------|
| Third Party Well | River Flow Direction |
| Third Party Facility | Hydrology |
| Facility | Waterbody |
| Oil Pipeline | Urban Area |
| Other Roads | Protected Area |
| Street | Grazing Lease |
| Main Hwy | AER Field Centre |
| Divided Hwy | Health Authority |
| Railway | Local Authority |
| Airfield | RCMP |
| Roadblock | Facility Boundary |
| Surface Development | CEPA EPZ |
| | CEPA EAZ |
| | Egress EPZ |

AREA OVERVIEW MAP

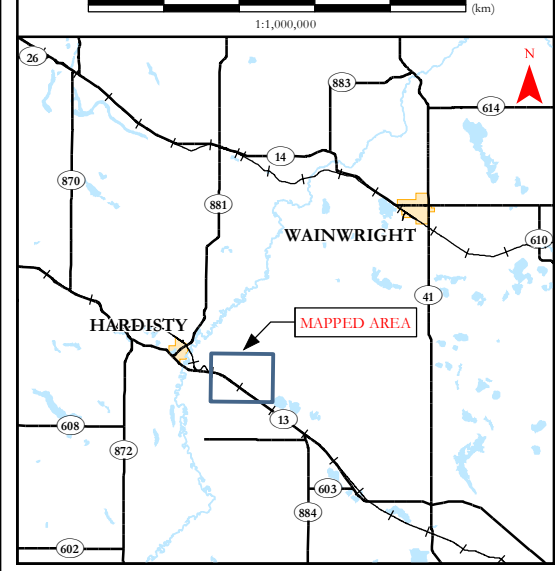

AER - WAINWRIGHT FIELD CENTRE
ALBERTA HEALTH SERVICES - Z3 CENTRAL
M.D. OF PROVOST NO. 52
RCMP - KILLAM - FORESTBURG